

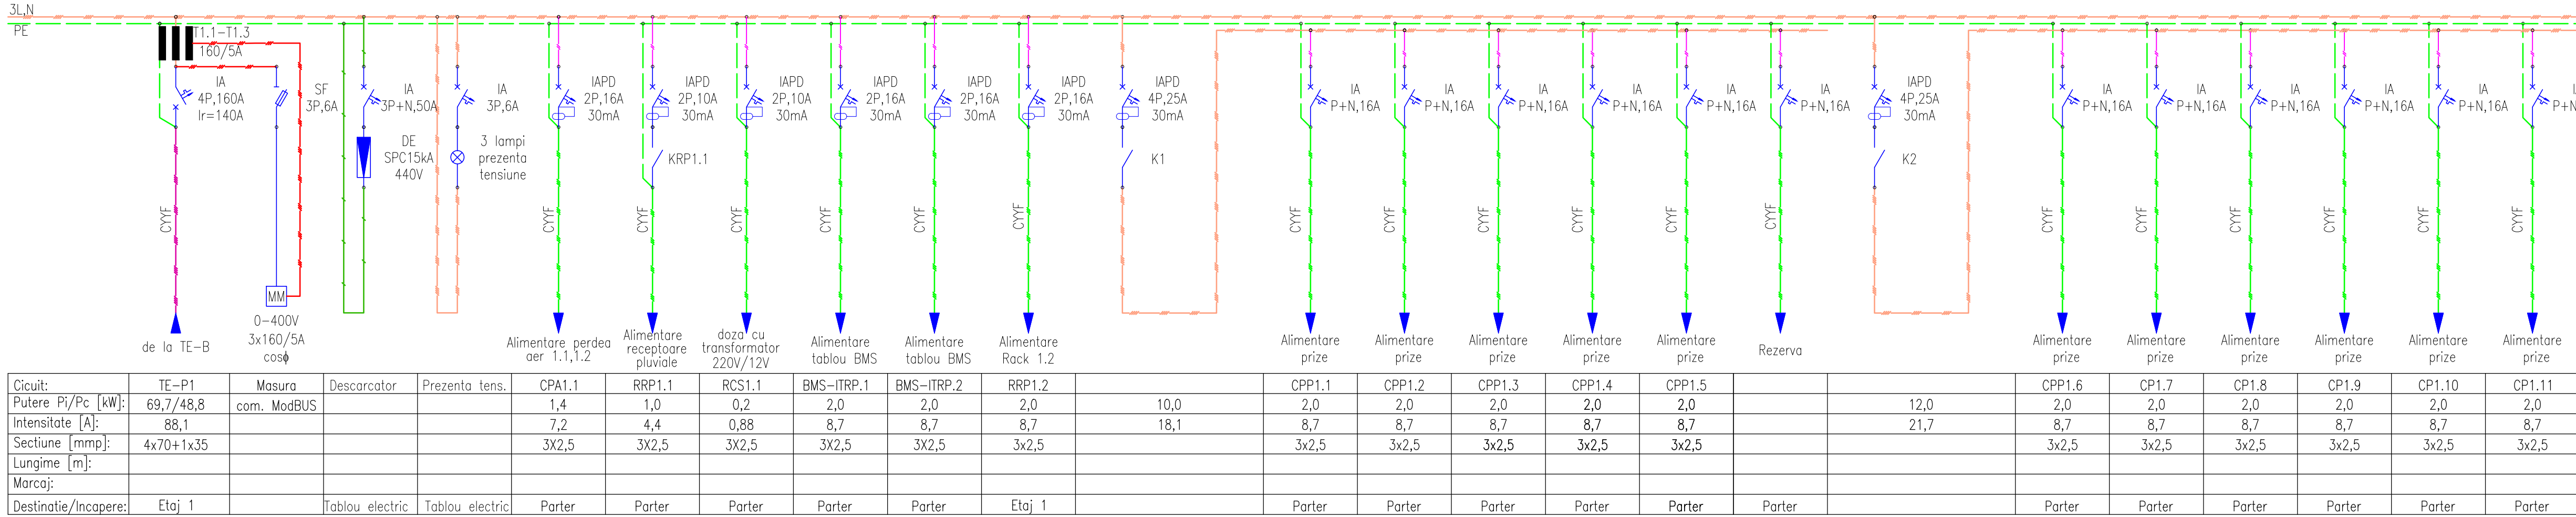


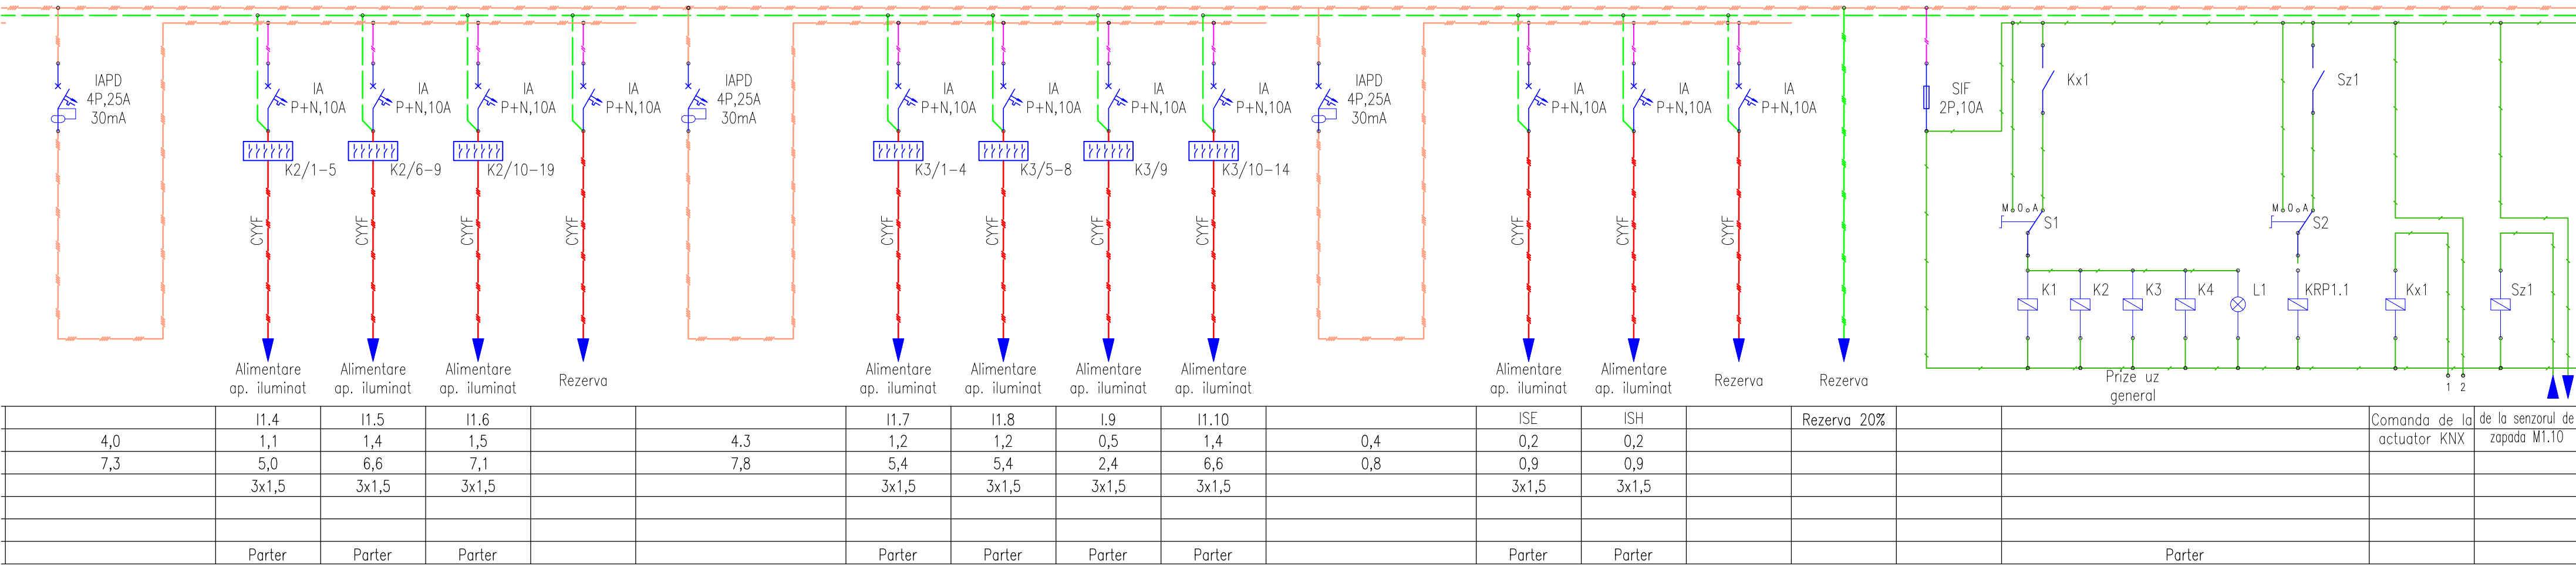

Nota:
Tabloul va fi metalic in montaj aparent, IP55.
Interruptoarele automate au curba de declansare C.

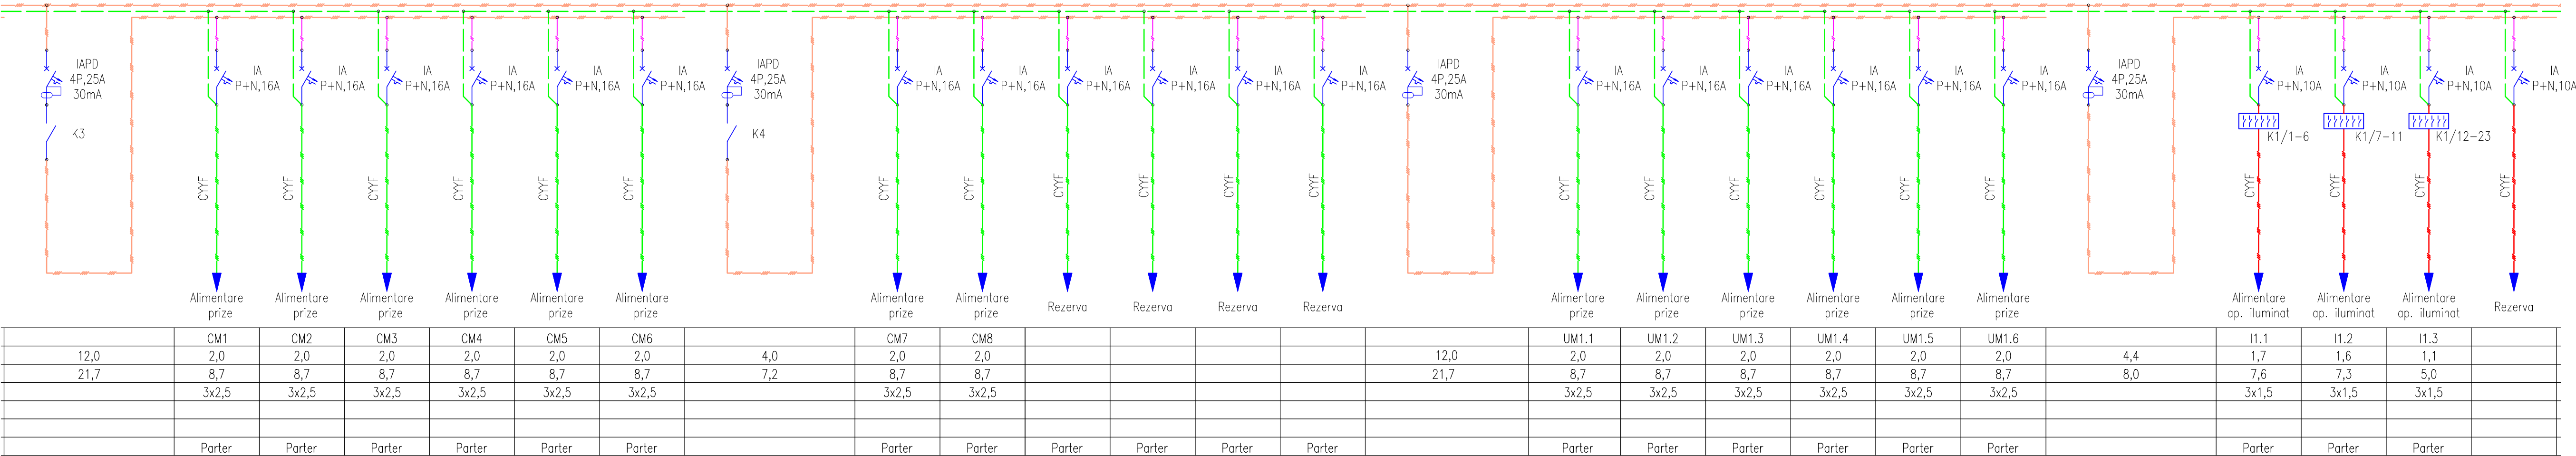

LEGENDA

- IA – interruptor automat
- IAPD – interruptor automat cu protectie diferentiala
- DE – descarcator debrosabil
- K...– contactor cu bobina 230V
- S...– selector cu doua sau trei pozitii
- CYF – cablu de energie electrica
- L – conductor de faza
- N – conductor de neutru
- PE – conductor de protectie

Categoria de importanta "C2" Constructie de importanta normala conform HGR 766/1997
Clasa de importanta: III, conform P100 si STAS 1010
Risc de incendiu : Hala Productie – mare ; Cladire Birouri, Casa Poarta, Camera Pompe-mic, conform P118/1999
Gradul de rezistenta la foc : II, conform P118/1999

20.11.2013	b.	IE	ing. Francisc ANTAL	ing. Francisc ANTAL	Suplimentare cu comanda circuitului de alimentare a receptorilor de pluviale
Data	Index	Deport	Dessnat	Proiectat	
Revisia					
Verificator	Dr. ing. POP FLORIN			Cerinta: IE	REFERAT NR. 5768/12.07.2013
dicositiganas					
Proiectant general:	DICO si TIGANAS				
Proiectant:	S.C. EMERSON ORADEA S.R.L.				
Adresa:	str. Primariei nr. 3, Oradea, jud.Bihar				
Proiectat:	FAZA 1 - HALA DE PRODUCTIE SI BIROURI M1.1, CASA POARTA, REZERVA DE INCENDIU CU CAMERA POMPE				
Dessnat:	ing. Liviu PETREUS				
Verificat:	ing. Liviu PETREUS				
Proiectat:	ing. Francisc ANTAL				
Dessnat:	ing. Francisc ANTAL				
Verificat:	ing. Liviu PETREUS				

Data	18.10.2013	Scara	---	Format	A1(841x594)	Nr. proiect	240	Faza	PT	Planse nr.	240/M1.1.O/PT/IE/D/014b
------	------------	-------	-----	--------	-------------	-------------	-----	------	----	------------	-------------------------